




**NOTES:**

1. REFER TO CRD STANDARD DRAWING 1.11 FOR STANDARD TRENCH DETAIL.
2. ALL WORK INVOLVING CRD WATER MAINS TO BE COORDINATED WITH AND UNDER THE DIRECTION OF CRD IWS.
3. EXTREME CARE SHALL BE TAKEN DURING CONSTRUCTION TO ENSURE NO DAMAGE TO THE AC WATER MAIN OCCURS AS IT BRIDGES THE SEWER TRENCH.

ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS NOTED

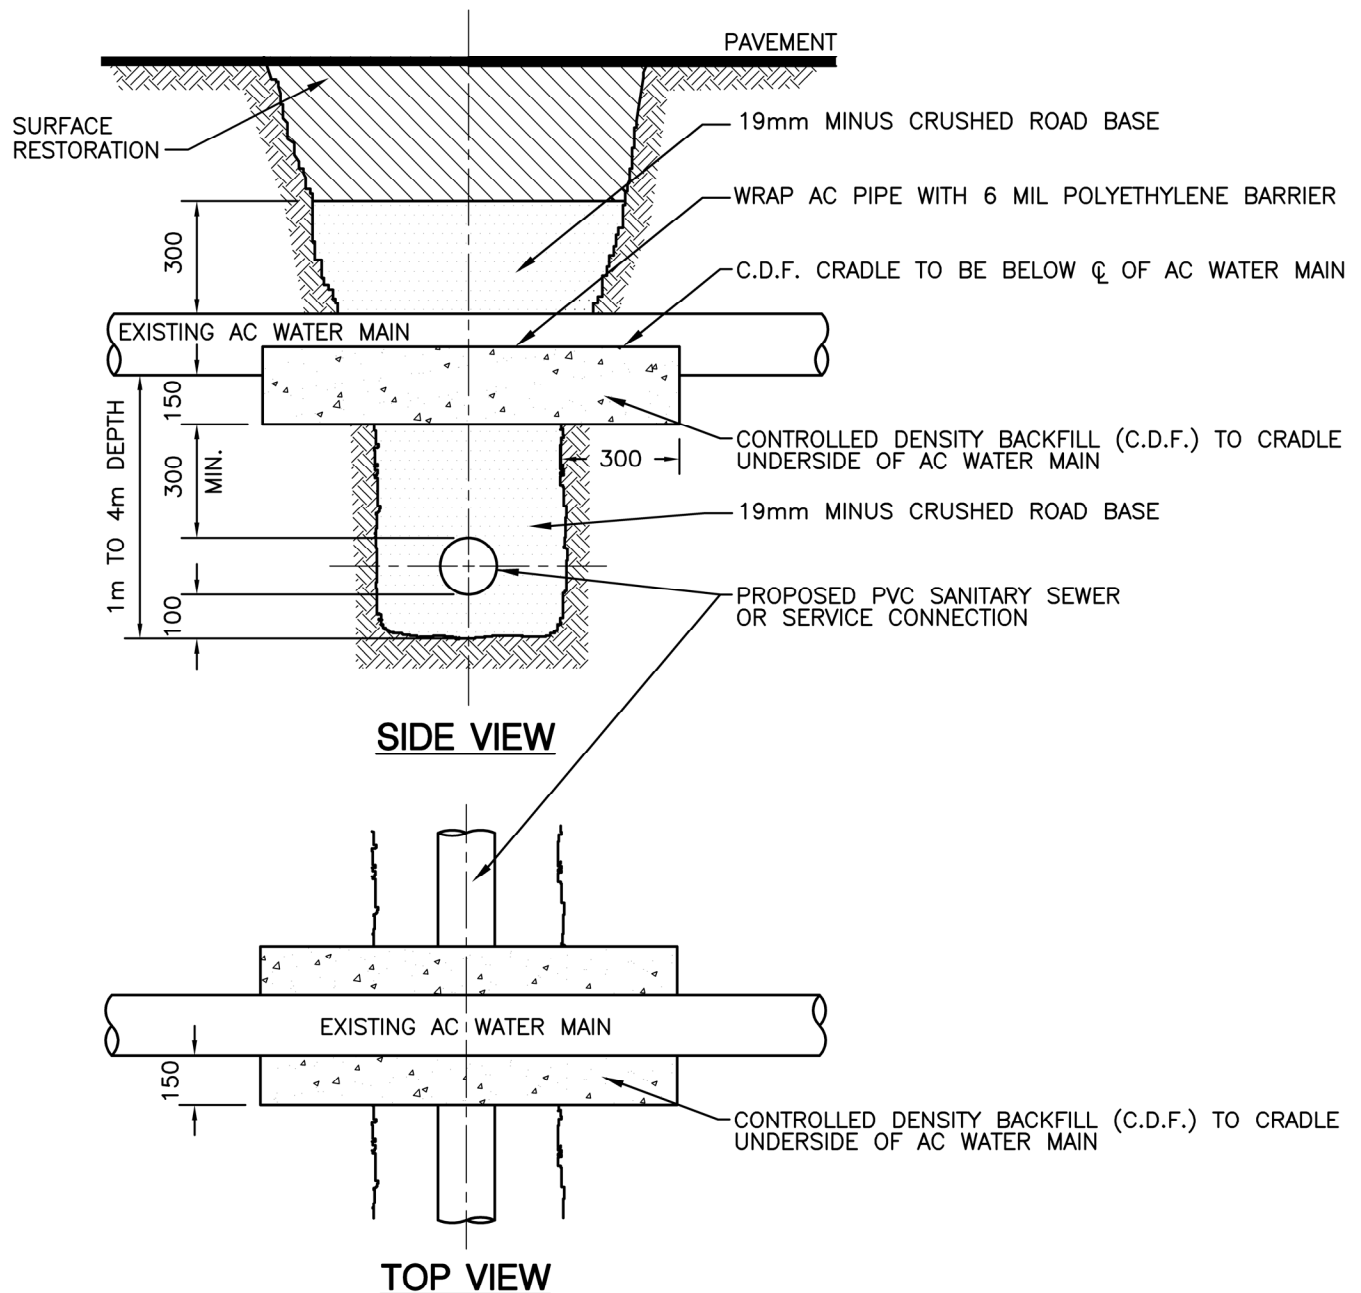

Making a difference...together

## SEWER CROSSING UNDER AC WATER MAIN

revision date: Sept. 2024 scale: N.T.S.

standard drawing no.:

**1.13**