
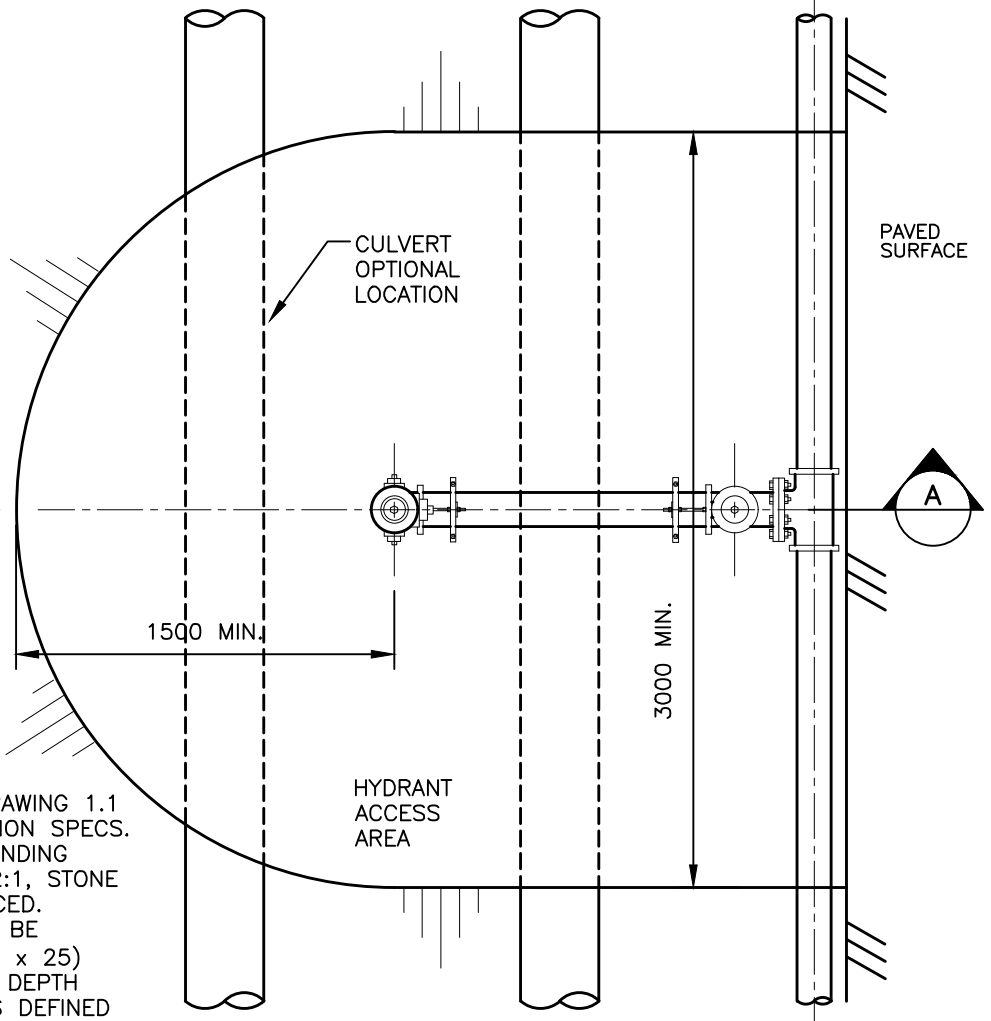


PROPERTY LINE




NOTES:

1. REFER TO STANDARD DRAWING 1.1 FOR HYDRANT INSTALLATION SPECS.
2. WHERE SLOPES SURROUNDING ACCESS AREA EXCEED 2:1, STONE RIP RAP SHALL BE PLACED.
3. CULVERT LENGTH SHALL BE MINIMUM $4000\text{mm} + (D \times 25)$ WHERE D IS THE DITCH DEPTH AND THE SIDE SLOPE IS DEFINED AS 1:1.
4. INSTALL STONE HEADWALLS ON CULVERTS.

PLAN

PROPERTY LINE

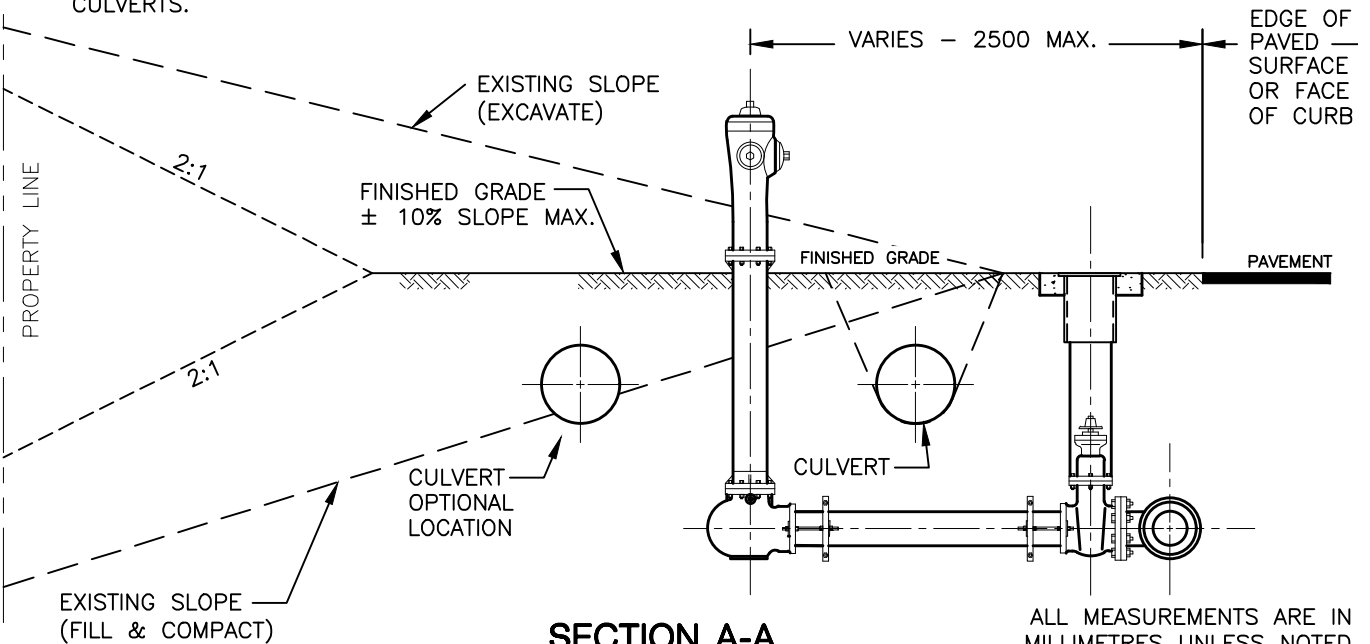

SECTION A-A

ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS NOTED



Making a difference...together

FIRE HYDRANT INSTALLATION IN DITCHED AREAS

revision date: Sept. 2024 scale: N.T.S.

standard drawing no.:

1.2