



Making a difference...together

FULFORD WATER SERVICE COMMISSION ANNUAL GENERAL MEETING

Notice of Meeting on Tuesday, November 2, 2021 at 10:00 AM
Fulford Community Hall, 2591 Fulford-Ganges Rd, Salt Spring Island, BC

Gary Holman

Anthony Maude

Carole Eyles

Gord Singbeil

Alan Martin

(r) regrets

Purpose of the Annual General Meeting

The agenda for the Annual General Meeting (AGM) is approved by the members of the Commission. The purposes (and hence the agenda items) of the meeting are:

- To have the last year's AGM minutes approved (by Commission members), and to present reports on the work of the Commission on the past year's operation, maintenance, capital upgrades and financial information of the service to the service residents and owners,
- To nominate members for appointment to the Commission, and
- To enable the public to share comments on subjects which relate to the work of the Commission. The Commission can identify (under "new business") issues on which it wants feedback at the meeting. Motions raised by the public at the AGM will be considered by the commission at a subsequent regular meeting.

The Annual General Meeting is for the 2020 fiscal year.

AGENDA

1. Territorial Acknowledgement / Call Meeting to Order

2. Limited Space Meeting Resolution

That this resolution applies to the Fulford Water Service Commission for the meeting being held on November 2, 2021, and that the attendance of the public at the place of the meeting will be limited in accordance with the applicable requirements or recommendations under the Public Health Act, despite the best efforts of the Commission because:

- a. The available meeting facilities cannot accommodate more than (175) people in person, including members of the Commission and staff, and
- b. There are no other facilities presently available that will allow physical attendance of the Commission and the public in sufficient numbers; and

That the Commission is ensuring openness, transparency, accessibility and accountability in respect of the open meeting by the following means:

- a. By making the meeting agenda, as well as the other relevant documents, available on the CRD website, and directing interested persons to the website by means of the notices provided in respect of the meeting,
- b. By making the minutes of the meeting available on the CRD website following the meeting.

Zoom Link: <https://us06web.zoom.us/j/85488011499>

To ensure quorum, advise Shayla Burnham 250 537 4448 if you cannot attend.

EXEC-1295039085-2414

3. Approval of Agenda 1-2
4. Adoption of Minutes of the 2019 Annual General Meeting held on November 3, 2020 3-4
5. Chair's Report
6. Report 5-14
 - 6.1 Annual Report for 2020 Fiscal Year
7. Election of Officers
8. New Business
9. Next Meeting - TBD
10. Adjournment



Making a difference...together

Minutes of the Annual General Meeting Fiscal Year 2019 of the FULFORD WATER SERVICE COMMISSION

Held Tuesday November 3, 2020 at the Fulford Hall. 2591 Fulford-Ganges Road, Salt Spring Island, BC

DRAFT

Present: **CRD Director:** Gary Holman
Commission Members: Carole Eyles, Gord Singbeil, Alan Martin, Anthony Maude
Staff: Karla Campbell, Manager, SSI Electoral Area; Allen Xu, Manager of SSI Engineering; Dan Robson, Manager, Saanich Peninsula and Gulf Islands Operations; Lia Xu, Manager, Financial Planning and Performance; Tracey Shaver, Recording Secretary.
Present: Elizabeth Nolan

1. Territorial Acknowledgement / Call Meeting to Order

Chair Eyles provided a territorial acknowledgement and called the meeting to order at 10:00 am

2. Limited Space Meeting Resolution

MOVED by Commissioner Singbeil, **SECONDED** by Commissioner Maude,
That this resolution applies to the Fulford Water Service Commission for the meeting being held on November 3, 2020, and that the attendance of the public at the place of the meeting will be limited in accordance with the applicable requirements or recommendations under the Public Health Act, despite the best efforts of the Commission because:

- a. The available meeting facilities cannot accommodate more than (30) people in person, including members of the Commission and staff, and
- b. There are no other facilities presently available that will allow physical attendance of the Commission and the public in sufficient numbers; and

That the Commission is ensuring openness, transparency, accessibility and accountability in respect of the open meeting by the following means:

- a. By making the meeting agenda, as well as the other relevant documents, available on the CRD website, and directing interested persons to the website by means of the notices provided in respect of the meeting,
- b. By making the minutes of the meeting available on the CRD website following the meeting.

CARRIED

3. Approval of Agenda

MOVED by Commissioner Martin, **SECONDED** by Commissioner Maude,
That the Fulford Water Service Commission Annual General for the Fiscal Year 2019 meeting agenda of November 3, 2020 be approved.

CARRIED

4. **Adoption of Minutes from the 2018 Annual General Meeting held on April 16, 2019**

MOVED by Commissioner Maude, **SECONDED** by Commissioner Singbeil,
That the Fulford Water Service Commission Fiscal Year 2018 Annual General meeting
minutes of April 16, 2019 be approved.

CARRIED

5. **Chair's Report**

- Chair Eyles provided a verbal and written copy of chair's report
- Three items requested in 2019 without resolution: 1) Breakdown of capital project expenses similar to monthly revenue and expense reports 2) Educational information regarding amount of stored water during power outages out to rate payers 3) Plan for strategic placement of water metres to detect leaks
- Request emergency numbers be part of quarterly bills
- Seeking update on Vortex project; developer invited to present to Commission.
- Waiting to review and provide input on water optimization report
- Seeking to build budget together with staff "in partnership"
- Seeking upfront consultation in development of contract work for local perspective (request for proposals)
- Requesting status on operating and maintenance contract with North Salt Spring Water District

6. **Report**

6.1 **Annual Report for 2019 Fiscal Year**

- Two items to be corrected in staff report. Page 2 under water production- remove reference to Cedar Lane. Page 5 under financial report- remove "not" before metered. Commercial properties are charged a consumption.

MOVED by Commissioner Martin, **SECONDED** by Commissioner Singbeil,
That the Fulford Water Service Commission receives the Fiscal Year 2019
Annual Report as corrected.

CARRIED

7. **Election of Officers**

Request for volunteers was advertised and having received no nominations both Commissioner Singbeil and Commissioner Martin were asked if they would continue for another term. Both accepted and will be reappointed for terms beginning in 2021

8. **New Business - none**

9. **Adjournment**

MOVED by Commissioner Martin, **SECONDED** by Commissioner Singbeil,
That the Fulford Water Service Commission adjourn the meeting at 10:56 am.

CARRIED

CHAIR

SENIOR MANAGER

Fulford Water Service

2020 Annual Report



INTRODUCTION

This report provides a summary of the Fulford Water Service for 2020. It includes a description of the service, summary of the water supply, demand and production, drinking water quality, operations highlights, capital project updates and financial report.

SERVICE DESCRIPTION

The Fulford Water Utility is a semi-rural residential community located on Salt Spring Island. It services the Fulford Elementary School and a small commercial component, including the BC Ferries Terminal. The service was created in 1968 as the Fulford Water Improvement District and became a CRD service in 2004. The Fulford Water Utility (Figure 1) is comprised of 102 parcels of land with 91 of those parcels connected to the water system. Within those 91 parcels, there are 96 single family equivalents (SFE) as the use on some parcels represent more than one dwelling.

The utility obtains its drinking water from Lake Weston, a small lake that lies within an uncontrolled multi-use watershed outside and northeast of the service area. The Capital Regional District (CRD) holds two licenses to divert a total of up to 291.6 cubic metres per day and store up to 49,339 cubic metres. Lake Weston is estimated to have a total volume of 1,090,000 cubic metres. Lake Weston is subject to seasonal water quality changes and is affected by periodic algae blooms.

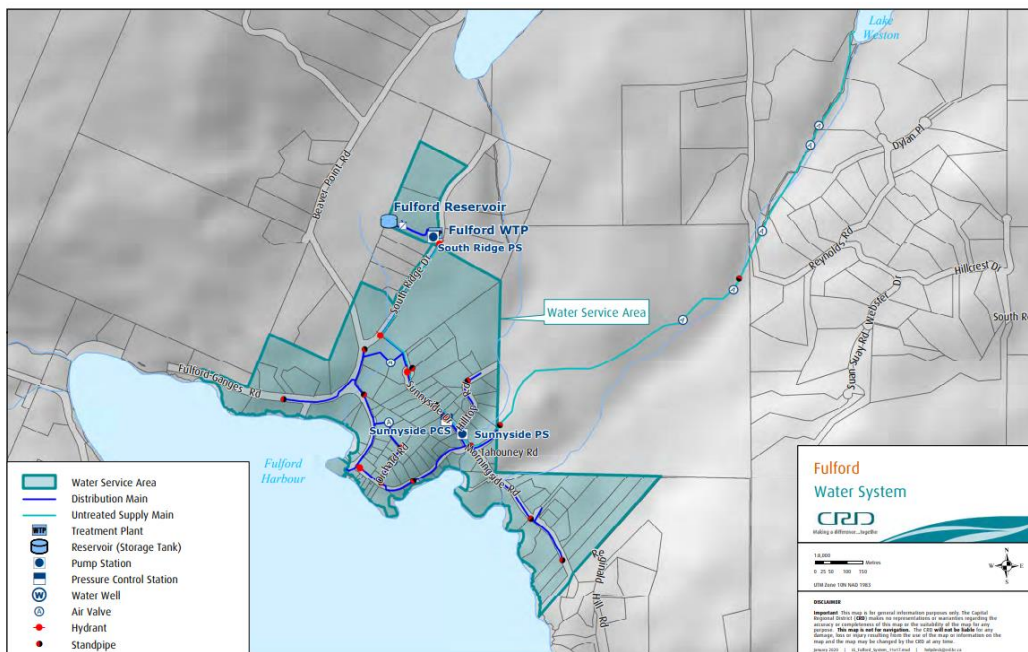


Figure 1: Fulford Water Service

The Fulford water system is primarily comprised of:

- a water treatment plant (WTP) that draws water from Lake Weston and treats it at a location on South Ridge Drive, adjacent to the Fulford Elementary School. The water is treated using a rapid mix system, flocculation, dissolved air floatation (DAF) and filters, ultraviolet disinfection, then chlorination prior to being pumped, via the distribution system to a reservoir. The water treatment plant (WTP) design flow rate is 4.5 litres/sec (60 lpm);
- one raw water pump station on Sunnyside Drive near Hilltop Road (flow rate of two pumps running is 2.3 litres/sec (30 lpm);
- approximately 4,500 m of water distribution pipe;
- 1 water reservoir – 360 m³ (80,000 l);
- fire hydrants, standpipes, and gate valves;
- water service connections complete with water meters on commercial properties only;
- 1 pressure reducing valve station on Sunnyside Drive near Hilltop Road.

WATER PRODUCTION AND DEMAND

Annual water production since 2015 is shown in Figure 2. A total of 30,494 m³ of water was extracted from Lake Weston in 2020. This is a 12% increase from the previous year and a 6% increase from the 5 year rolling average.

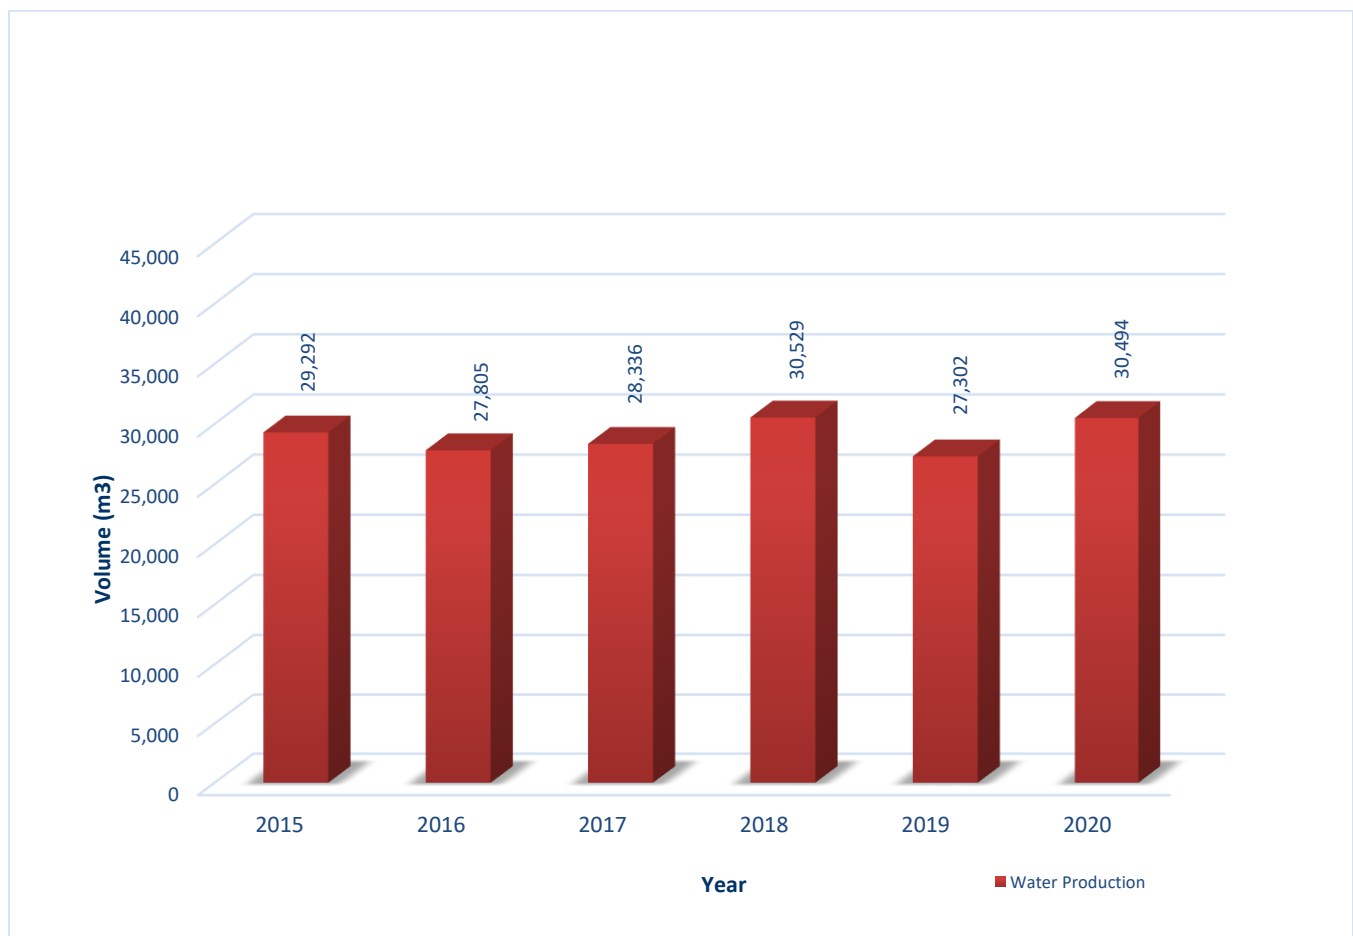


Figure 2: Fulford Water Service Annual Water Production

Water production by month for the past five years is shown in Figure 3. The monthly water production trends are typical for small water systems such as the Fulford water system. Water production during September to November was higher due to two water system leaks that were difficult to locate.

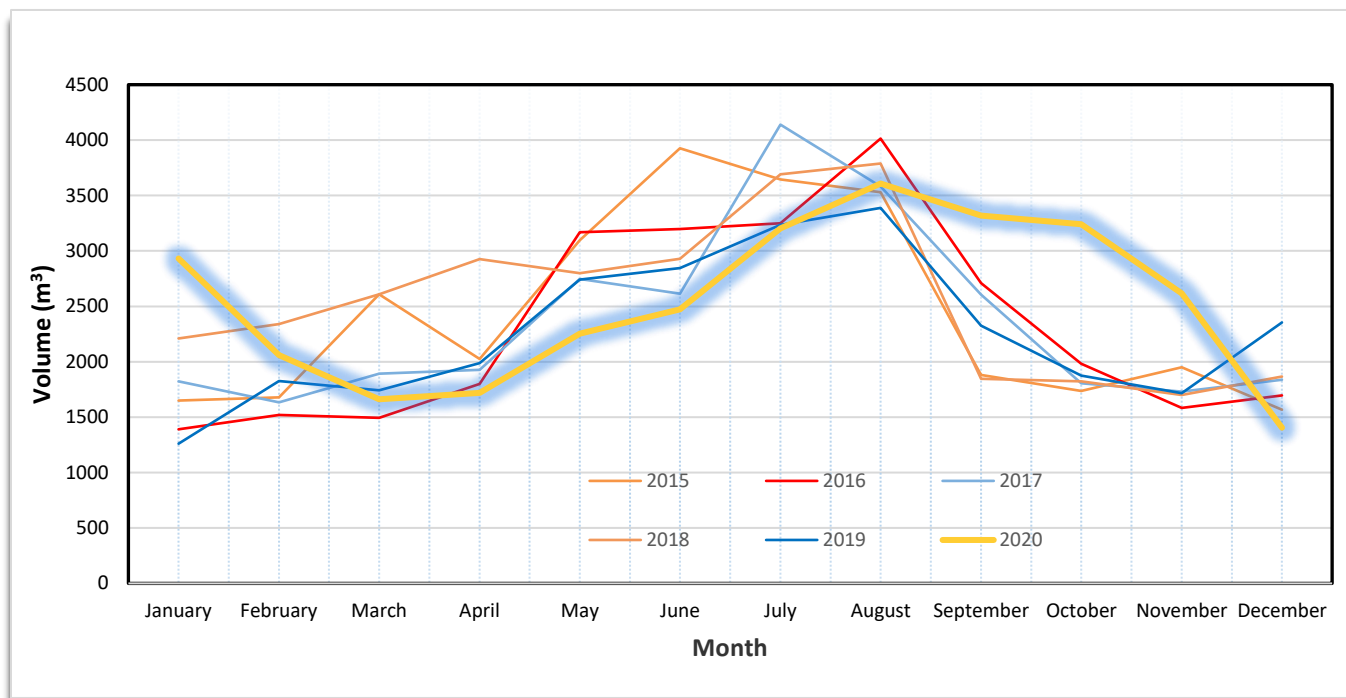


Figure 3: Fulford Water Service Monthly Water Production

The Fulford Water System does not have residential water meters and therefore the average per single family equivalent (SFE) is simply a calculated value. Utilizing 95 SFE and deducting an allowance of 20% for non-revenue water such as water system leaks, fire hydrant usage and water system maintenance and operational use (water main flushing, filter system backwashing), the average SFE is 257m³ per year for 2020. This is a 6% increase from the 5 year rolling average.

WATER QUALITY

In general, the Fulford Water System provided good quality drinking water to its customers in 2020. A number of samples for a variety of water quality parameters were collected and analysed throughout the year and confirmed that the DAF and disinfection treatment stages were effective in treating raw water from Lake Weston.

Typical Fulford drinking water quality characteristics for 2020 are summarized as follows:

Raw Water:

Lake Weston exhibited low concentrations of total coliform bacteria (TC) throughout most parts of the year with higher concentrations during the summer months. E. coli bacteria were only found in very low concentrations with slightly higher concentrations in the summer.

No parasitic cysts and oocysts (Giardia and Cryptosporidium) were detected in the raw source water from the lake.

Raw water from the lake was slightly hard (annual median 34.1 mg/L CaCO₃).

A total organic carbon (TOC) concentration range from 4.50 to 5.30 mg/L indicates a mesotrophic (semi-productive) lake status. This has been consistent with historic data.

Four metal test results showed moderately low iron and very low manganese concentrations in the raw water. These metals in exceedance of the Guidelines for Canadian Drinking Water Quality (GCDWQ) limits can cause, if untreated, aesthetic issues such as water discolouration. The raw water colour was consistently elevated which may be a result of iron concentrations plus tannin and lignin, all natural components found in local lakes.

The raw water turbidity (cloudiness) was consistently very low with the highest values slightly over 1 nephelometric turbidity units (NTU) during the winter months.

Treated Water:

Treated water was bacteriologically safe to drink; no indicator bacteria were found in any sample throughout the year.

Treated water turbidity was well below the GCDWQ limit of 1 NTU;

TOC (median 2.20 mg/L) in the treated water was consistent with historic trends. As TOC is a precursor for disinfection by-products, concentrations consistently much higher than 2 mg/L can lead to exceedances with these substances.

Disinfection by-products such as trihalomethanes (THM) were well below the GCDWQ limit of 100 µg/L with an annual average of 62.5 µg/L. In the past, there have been occasional single-test results above the guideline limit. Haloacetic acids (HAA) were not tested in 2020 due to a history of concentrations consistently well below the GCDWQ limit of 80 µg/L. Tests for HAA disinfection by-products will be carried out in 2021.

The water temperature was in exceedance of the aesthetic objective of 15°C between July 8 and October 7, 2020. There is no mitigation for this.

The free chlorine residual concentrations in the distribution system were within the desired range (0.29 – 2.14 mg/L) and indicate an effective secondary disinfection process.

Table 1 and 2 below provide a summary of the 2020 raw and treated water test results.

Water Quality data collected from this drinking water system can be reviewed on the CRD website:

<https://www.crd.bc.ca/about/data/drinking-water-quality-reports/>

OPERATIONAL HIGHLIGHTS

The following is a summary of the major operational issues that were addressed by during the 2020 reporting period:

- Water system leak repairs:
 - 133 Sunnyside Road
 - 201 Morningside Road
 - 2900 Fulford Ganges Road
 - 881 Fulford Ganges Road
 - 2905 Fulford Ganges Road
 - 117 Hilltop Road (Resulted in a boil water advisory)

- Morningside Road at Orchard Road
- 112 Beaver Point Road

CAPITAL IMPROVEMENTS

The following is a summary of the major capital improvements including year ending spending for 2020:

Asset Management Plan (CE.641.4501): A prioritized list of infrastructure replacements, which will serve as the basis for future capital spending plans.

Project	Spending
Budget	\$10,000
Project Management	(\$135)
Contract	(\$9,293)
Project Closed Balance Returned to CWF	\$572

Decommission Reynolds Road Strainer Facility (CE.700.4601): Demolition of the existing wooden structure in poor condition and remedy to ensure worker safety, maintain a reliable and efficient level of service for potable water supply, as well as reduce overall risk to the water service area. Involves disconnecting electrical services, demolition and disposal of existing wooden building, and design, fabrication and installation of an aluminum access hatch on top of the concrete chamber.

Project	Spending
Budget	\$27,750
Project Management	(\$5,283)
Contract	(\$17,670)
Project Closed Balance Returned to CRF	\$4,788

Weston Creek on Morningside Road (CE.507.4601): The water main along Morningside Road is exposed and spans Weston Creek making it susceptible to damage by people, vehicles, rocks or stream debris. Due to a wet year in 2019 and high stream water level, this project was deferred until the next dry season.

Project	Spending
Budget	\$60,600
Project Management	(\$13,866)
Contract	(\$27,392)
Balance Remaining	\$19,342

Safe Work Procedures (CE.699.4504): The work scope includes reviewing and developing safe work procedures for operational and maintenance tasks

Project	Spending
Budget	\$11,000
Project Management	(\$296)
Contract	(\$2,292)
Supplies/Materials	(\$209)
Total Project	\$8,204

Back-up Power Design (CE.735): Complete electrical designs for new onsite back up power.

Project	Spending
Budget	\$10,000
Project Management	(\$73)
Balance Remaining	\$9,927

2020 FINANCIAL REPORT

Please refer to the attached 2020 Financial Report. Revenue includes parcel taxes (Transfers from Government), fixed user fees (User Charges), water sales (Sale-Water), interest on savings (Interest Earnings), a transfer from the Operating Reserve Fund, and miscellaneous revenue such as late payment charges (Other Revenue).

Expenses includes all costs of providing the service. General Government Services includes budget preparation, financial management, utility billing and risk management services. CRD Labour and Operating Costs includes CRD staff time as well as the costs of equipment, tools and vehicles. Debt servicing costs are interest and principal payments on long term debt. Other Expenses includes all other costs to administer and operate the water system, including insurance, supplies, water testing and electricity.

The difference between Revenue and Expenses is reported as Net Revenue (expenses). Any transfers to or from capital or reserve funds for the service (Transfers to Own Funds) are deducted from this amount and it is then added to any surplus or deficit carry forward from the prior year, yielding an Accumulated Surplus (or deficit) that is carried forward to the following year.

WATER SYSTEM PROBLEMS - WHO TO CALL:

To report any event or to leave a message regarding the Fulford water system, call either:

CRD water system emergency call centre:	1-855-822-4426 (toll free)
CRD water system emergency call centre:	1-250-474-9630 (toll)
CRD water system general enquiries	1-800-663-4425 (toll free)

When phoning with respect to an emergency, please specify to the operator, the service area in which the emergency has occurred.

Submitted by:	Matthew McCrank, MSc., P.Eng, Senior Manager, Wastewater Infrastructure Operations
	Glenn Harris, Ph.D., R.P.Bio., Senior Manager, Environmental Protection
	Rianna Lachance, BCom, CPA, CA, Senior Manager Financial Services
	Karla Campbell, BPA, Senior Manager, Salt Spring Island Electoral Area
Concurrence	Ted Robbins, BSc, C.Tech, General Manager, Integrated Water Services

Attachments:

Table 1: 2020 Summary of Raw Water Test Results, Fulford Water System

Table 2: 2020 Summary of Treated Water Test Results, Fulford Water System

Attachment 1: [2020 Financial Report](#)

For questions related to this Annual Report please email saltspring@crd.bc.ca

Table 1: 2020 Summary of Raw Water Test Results, Fulford Water System

PARAMETER		2020 ANALYTICAL RESULTS				CANADIAN GUIDELINES	2010 - 2019 RESULTS		
Parameter Name	Units of Measure	Annual Median	Samples Analyzed	Range Minimum Maximum		≤ = Less than or equal to	Median	Samples Analyzed	Range Minimum-Maximum
ND means Not Detected by analytical method used									
Physical Parameters/Biological									
Chlorophyll a	ug/L	2.54	4	0.87	5.60	≤ 15 AO	1.16	48	ND - 28.5
Colour, True	TCU	20	12	15	32		21	57	1.20 - 29.4
Conductivity @ 25C	uS/cm	Last analyzed in 2011				No Guideline Required	35.5	14	30.9 - 61.3
Hardness as CaCO ₃	mg/L	34.1	4	28.9	36.2				
pH	pH Units	7.10	3	7.00	7.10	7.0-10.5 AO	7.20	20	6.84 - 7.50
Carbon, total organic	mg/L	5.20	4	4.50	5.30		5.54	20	3.92 - 7.00
Turbidity	NTU	0.45	12	0.30	1.50		0.62	97	0.20 - 4.92
Water Temperature	Degrees C	13.6	17	7.5	18.0		12.0	530	2.5 - 20.0
Microbial Parameters									
Indicator Bacteria									
Coliform, Total	CFU/100 mL	49	10	1	760		23	97	0 - 5500
<i>E. coli</i>	CFU/100 mL	ND	13	ND	3		0.5	97	ND - 4
Hetero. Plate Count, 7 day	CFU/1 mL	Not tested in 2020					1110	39	90 - 4000
Parasites						No MAC Established			
<i>Cryptosporidium</i> , Total oocysts	oocysts/100 L	ND	2	ND	0	Zero detection desirable	ND	14	0 - 2.80
<i>Giardia</i> , Total cysts	cysts/100 L	ND	2	ND	0	Zero detection desirable	ND	14	0 - 0.55
Algal Toxins									
Anatoxin A	ug/L	Last analyzed in 2011					ND	16	ND - 0.0
Cylindrospermopsin	ug/L	Last analyzed in 2011					ND	16	ND - 0.0
Microcystin-RR	ug/L	Last analyzed in 2011					ND	16	ND - 0.0
Microcystin-YR	ug/L	Last analyzed in 2011					ND	16	ND - 3.51
Microcystin-LR	ug/L	Last analyzed in 2011					ND	16	ND - 0.65
Total Microcystins	ug/L	Last analyzed in 2011				1.5 MAC	ND	16	ND - 4.16
Nodularin	ug/L	Last analyzed in 2011					ND	16	ND - 0.0
Metals									
Aluminum	ug/L as Al	17.4	4	5.80	138.0	2900 MAC / 100 OG	17.5	14	ND - 4600
Antimony	ug/L as Sb	ND	4	ND	0.0	6 MAC	ND	14	ND - 0.0
Arsenic	ug/L as As	0.25	4	0.21	0.26	10 MAC	0.25	14	0.20 - 0.82
Barium	ug/L as Ba	6.10	4	5.70	6.80	100 MAC	6.20	14	ND - 7.80
Beryllium	ug/L as Be	ND	4	ND	0.0		ND	14	ND - 0.0
Bismuth	ug/L as Bi	ND	4	ND	0.0		ND	12	ND - 0.0
Boron	ug/L as B	ND	4	ND	0.0	5000 MAC	ND	14	ND - 0.0
Cadmium	ug/L as Cd	ND	4	ND	0.0	5 MAC	ND	17	ND - 0.02
Calcium	mg/L as Ca	10.95	4	9.20	11.6	No Guideline Required	11.45	14	9.86 - 17.5
Chromium	ug/L as Cr	ND	4	ND	0.0	50 MAC	ND	14	ND - 0.0
Cobalt	ug/L as Co	ND	4	ND	0.0		ND	14	ND - 0.0
Copper	ug/L as Cu	7.91	4	6.25	17.5	2000 MAC / ≤ 1000 AO	7.23	14	ND - 55.0
Iron	ug/L as Fe	72.4	4	51.7	112.0	≤ 300 AO	65.25	14	12.0 - 156.0
Lead	ug/L as Pb	0.33	4	ND	1.08	5 MAC	0.35	14	ND - 0.63
Lithium	ug/L as Li	ND	4	ND	0.0		ND	6	ND - 0.0
Magnesium	mg/L as Mg	1.65	4	1.44	1.76	No Guideline Required	1.68	14	1.51 - 4.28
Manganese	ug/L as Mn	6.40	4	2.20	15.4	120 MAC / ≤ 20 AO	4.35	14	ND - 48.0
Molybdenum	ug/L as Mo	ND	4	ND	0.0		ND	14	ND - 0.0
Nickel	ug/L as Ni	0.80	4	ND	2.30		ND	14	ND - 2.40
Potassium	mg/L as K	0.55	4	0.53	0.59		0.56	14	0.03 - 0.67
Selenium	ug/L as Se	ND	4	ND	0.0	50 MAC	ND	13	ND - 0.10
Silicon	ug/L as Si	1835	4	409	2990		1975	14	2.48 - 10800
Silver	ug/L as Ag	ND	4	ND	0.0	No Guideline Required	ND	14	ND - 0.0
Sodium	mg/L as Na	5.26	4	4.55	5.60	≤ 200 AO	5.79	14	3.98 - 9.66
Sulphur	mg/L as S	ND	4	ND	0.0		ND	12	ND - 0.0
Strontium	ug/L as Sr	32.25	4	26.3	34.3	7000 MAC	32.55	14	27.0 - 55.0
Tin	ug/L as Sn	ND	4	ND	0.0		ND	13	ND - 0.0
Thallium	ug/L as Tl	ND	4	ND	0.0		ND	12	ND - 0.0
Titanium	ug/L as Ti	ND	4	ND	0.0		ND	14	ND - 0.0
Uranium	ug/L as U	ND	4	ND	0.0	20 MAC	ND	12	ND - 0.0
Vanadium	ug/L as V	ND	4	ND	0.0		ND	14	ND - 0.0
Zinc	ug/L as Zn	18.0	4	7.3	23.5	≤ 5000 AO	13.0	14	8.90 - 297.0
Zirconium	ug/L as Zr	ND	4	ND	0.14		ND	12	ND - 0.0

Table 2: 2020 Summary of Treated Water Test Results, Fulford Water System									
PARAMETER		2020 ANALYTICAL RESULTS				CANADIAN GUIDELINES	2010 - 2019 RESULTS		
Parameter	Units of	Annual	Samples	Range		≤ = Less than or equal to		Samples	Range
Name	Measure	Median	Analyzed	Min.	Max.		Median	Analyzed	Min.-Max.
ND means Not Detected by analytical method used									
Physical Parameters									
Alkalinity, Total	mg/L		Last analyzed in 2014				25.0	1	25.0 - 25.0
Carbon, Total Organic	mg/L as C	2.20	4	2.00	2.70		2.4	35	ND - 8.04
Colour, True	TCU		Last analyzed in 2011			≤ 15 AO	1	3	ND - 23
Hardness as CaCO ₃	mg/L	33.4	4	28.8	35.2	No Guideline Required	34.0	8	30.5 - 46.7
pH	pH units	6.90	3	6.10	6.90	7.0-10.5 AO	6.92	23	6.75 - 7.53
Turbidity	NTU	ND	12	ND	0.0	1 MAC and ≤ 5 AO	0.16	124	ND - 6.44
Water Temperature	Degress C	8.0	147	5.5	19.5		11.5	2105	0.0 - 22.0
Microbial Parameters									
Indicator Bacteria									
Coliform, Total	CFU/100 mL	ND	78	ND	0	0 MAC	ND	439	0 - 9
<i>E. coli</i>	CFU/100 mL	ND	78	ND	0	0 MAC	ND	437	ND - 0
Hetero. Plate Count, 7 day	CFU/1 mL	Not tested in 2020				No Guideline Required	ND	40	0 - 110
Algal Toxins									
Anatoxin A	ug/L	Last analyzed in 2011					ND	1	ND - 0.0
Cylindrospermopsin	ug/L	Last analyzed in 2011					ND	1	ND - 0.0
Microcystin-RR	ug/L	Last analyzed in 2011					ND	1	ND - 0.0
Microcystin-YR	ug/L	Last analyzed in 2011					ND	1	ND - 0.0
Microcystin-LR	ug/L	Last analyzed in 2011					ND	1	ND - 0.0
Total Microcystins	ug/L	Last analyzed in 2011				1.5 MAC	ND	1	ND - 0.0
Nodularin	ug/L	Last analyzed in 2011					ND	1	ND - 0.0
Disinfectants									
Disinfectants									
Chlorine, Free Residual	mg/L as Cl ₂	0.77	151	0.29	2.14	No Guideline Required	0.64	2436	0.08 - 2.20
Chlorine, Total Residual	mg/L as Cl ₂	0.90	151	0.42	2.24	No Guideline Required	0.77	2279	0.0 - 2.20
Disinfection By-Products									
Trihalomethanes (THMs)									
Bromodichloromethane	ug/L	12.5	4	12.0	14.0		13.0	31	8.76 - 24.0
Bromoform	ug/L	ND	4	ND	0.0		ND	13	ND - 1.59
Chloroform	ug/L	49.5	4	41.0	52.0		56.8	30	27.0 - 130.0
Chlorodibromomethane	ug/L	1.60	4	1.50	2.00		1.80	31	ND - 5.46
Total Trihalomethanes	ug/L	63.5	4	56.0	67.0	100 MAC	77.0	31	38.8 - 160.0
HAA5	ug/L	Not analyzed in 2020					24.3	5	5.10 - 28.6
Metals									
Aluminum	ug/L as Al	11.0	4	7.30	14.9	2900 MAC / 100 OG	32.50	9	ND - 228.0
Antimony	ug/L as Sb	ND	4	ND	0.0	6 MAC	ND	8	ND - 0.0
Arsenic	ug/L as As	0.13	4	ND	0.18	10 MAC	0.24	8	ND - 0.84
Barium	ug/L as Ba	5.85	4	5.20	6.40	100 MAC	5.15	8	ND - 6.3
Beryllium	ug/L as Be	ND	4	ND	0.0		ND	8	ND - 0.0
Bismuth	ug/L as Bi	ND	4	ND	0.0		ND	4	ND - 0.0
Boron	ug/L as B	ND	4	ND	0.0	5000 MAC	ND	8	ND - 0.0
Cadmium	ug/L as Cd	ND	4	ND	0.0	5 MAC	ND	8	ND - 0.04
Calcium	mg/L as Ca	10.7	4	9.20	11.3	No Guideline Required	11.25	8	9.74 - 15.6
Chromium	ug/L as Cr	ND	4	ND	0.0	50 MAC	ND	8	ND - 0.0
Cobalt	ug/L as Co	ND	4	ND	0.0		ND	8	ND - 0.0
Copper	ug/L as Cu	14.55	4	10.6	18.0	2000 MAC / ≤ 1000 AO	ND	8	ND - 0.0
Iron	ug/L as Fe	ND	4	ND	0.0	≤ 300 AO	15.3	8	ND - 47.0
Lead	ug/L as Pb	0.31	4	0.27	0.42	5 MAC	0.35	8	ND - 2.43
Lithium	ug/L as Li	ND	1	ND	0.0				
Magnesium	mg/L as Mg	1.62	4	1.42	1.71	No Guideline Required	1.56	8	0.89 - 1.85
Manganese	ug/L as Mn	ND	4	ND	0.0	120 MAC / ≤ 20 AO	ND	8	ND - 1.2
Molybdenum	ug/L as Mo	ND	4	ND	0.0		ND	8	ND - 0.0
Nickel	ug/L as Ni	ND	4	ND	0.0		ND	8	ND - 0.0
Potassium	mg/L as K	0.53	4	0.52	0.59		0.50	8	ND - 0.62
Selenium	ug/L as Se	ND	4	ND	0.0	50 MAC	ND	7	ND - 0.0
Silicon	ug/L as Si	1665	4	353	2760		1600	8	3.17 - 2680
Silver	ug/L as Ag	ND	4	ND	0.0	No Guideline Required	ND	8	ND - 0.0
Sodium	mg/L as Na	7.16	4	6.46	7.64	≤ 200 AO	6.86	8	4.56 - 7.6
Sulphur	mg/L as S	ND	4	ND	0.0		ND	4	ND - 0.0
Strontium	ug/L as Sr	32.25	4	26.2	33.2	7000 MAC	31.15	8	26.0 - 39.0
Tin	ug/L as Sn	ND	4	ND	0.0		ND	7	ND - 0.0
Thallium	ug/L as Tl	ND	4	ND	0.0		ND	4	ND - 0.0
Titanium	ug/L as Ti	ND	4	ND	0.0		ND	8	ND - 0.0
Uranium	ug/L as U	ND	4	ND	0.0	20 MAC	ND	4	ND - 0.0
Vanadium	ug/L as V	ND	4	ND	0.0		ND	8	ND - 0.0
Zinc	ug/L as Zn	15.6	4	7.90	21.5	≤ 5000 AO	17.45	8	ND - 186
Zirconium	ug/L as Zr	ND	4	ND	0.0		ND	4	ND - 0.0

CAPITAL REGIONAL DISTRICT

FULFORD WATER

Statement of Operations (Unaudited)

For the Year Ended December 31, 2020

	2020	2019
Revenue		
Transfers from government	66,359	74,790
User Charges	132,053	119,835
Sale - Water	17,148	17,053
Other revenue from own sources:		
Interest earnings	44	363
Transfer from Operating Reserve	6,393	8,000
Other revenue	10,028	474
Total Revenue	232,024	220,516
Expenses		
General government services	8,380	8,471
Contract for Services	95,430	68,369
CRD Labour and Operating costs	29,132	19,679
Debt Servicing Costs	53,187	55,473
Other expenses	38,615	37,273
Total Expenses	224,744	189,264
Net revenue (expenses)	7,280	31,252
Transfers to own funds:		
Capital Reserve Fund	-	24,112
Operating Reserve Fund	7,280	7,140
Annual surplus/(deficit)	-	-
Accumulated surplus/(deficit), beginning of year	-	-
Accumulated surplus/(deficit), end of year	\$ -	-

CAPITAL REGIONAL DISTRICT

FULFORD WATER

Statement of Reserve Balances (Unaudited)

For the Year Ended December 31, 2020

	Capital Reserve	
	2020	2019
Beginning Balance	89,131	99,187
Transfer from Operating Budget	-	24,112
Transfers from Completed Capital Projects	5,447	1,415
Transfer to Capital Project	(22,750)	(38,100)
Interest Income	1,574	2,517
Ending Balance	73,402	89,131

	Operating Reserve	
	2020	2019
Beginning Balance	16,956	17,212
Transfer from Operating Budget	7,280	7,140
Transfer to Operating Budget	(6,393)	(8,000)
Interest Income	413	604
Ending Balance	18,256	16,956