

CAPITAL REGIONAL DISTRICT - INFRASTRUCTURE & WATER SERVICES**Water Watch**

Issued March 30, 2026

Water Supply System Summary:**1. Useable Volume in Storage:**

Reservoir	March 31 5 Year Ave		March 31/25		March 29/26		% Existing Full Storage
	ML	MIG	ML	MIG	ML	MIG	
Sooke	92,727	20,400	92,727	20,400	92,727	20,400	100.0%
Goldstream	9,675	2,129	9,825	2,161	9,906	2,179	99.9%
Total	102,402	22,529	102,552	22,561	102,633	22,579	100.0%

2. Average Daily Demand:

For the month of March	106.0 MLD	23.3 MIGD
For week ending March 29, 2026	106.5 MLD	23.4 MIGD
Max. day March 2026, to date:	109.9 MLD	24.2 MIGD

3. Average 5 Year Daily Demand for March

Average (2021 - 2025)	105.4 MLD ¹	23.2 MIGD ²
-----------------------	------------------------	------------------------

¹MLD = Million Litres Per Day ²MIGD = Million Imperial Gallons Per Day

4. Rainfall March:

Average (1914 - 2025):	158.6 mm
Actual Rainfall to Date	220.9 mm (139% of monthly average)

5. Rainfall: Sep 1- Mar 29

Average (1914 - 2025):	1,403.2 mm
2025/2026	1,534.9 mm (109% of average)

6. Water Conservation Required Action:

Spring is a great time to check for leaks in your home and yard.

A leaky toilet can waste 20 - 40 litres of water per hour.

Learn how to find and fix leaks on our website at:

<https://www.crd.ca/environment/water-conservation/conserving-water-home/fix-leak>

For general information regarding water conservation, visit the CRD webpage linked below:

CRD Water Conservation Homepage: <https://www.crd.ca/environment/water-conservation>

If you require further information, please contact:

Alicia Fraser, P. Eng.
General Manager, CRD - Infrastructure and Water Services
or
Glenn Harris, Ph D., RPBio
Senior Manager - Environmental Protection


CRD Infrastructure & Water Services
479 Island Highway
Victoria, BC V9B 1H7
(250) 474-9600

Daily Consumption

March 2026


Consumption (Million Litres)

Average Daily Consumption = 106.0 M.L.



01 (Sun) 02 (Mon) 03 (Tue) 04 (Wed) 05 (Thu) 06 (Fri) 07 (Sat) 08 (Sun) 09 (Mon) 10 (Tue) 11 (Wed) 12 (Thu) 13 (Fri) 14 (Sat) 15 (Sun) 16 (Mon) 17 (Tue) 18 (Wed) 19 (Thu) 20 (Fri) 21 (Sat) 22 (Sun) 23 (Mon) 24 (Tue) 25 (Wed) 26 (Thu) 27 (Fri) 28 (Sat) 29 (Sun) 30 (Mon) 31 (Tue)

Day

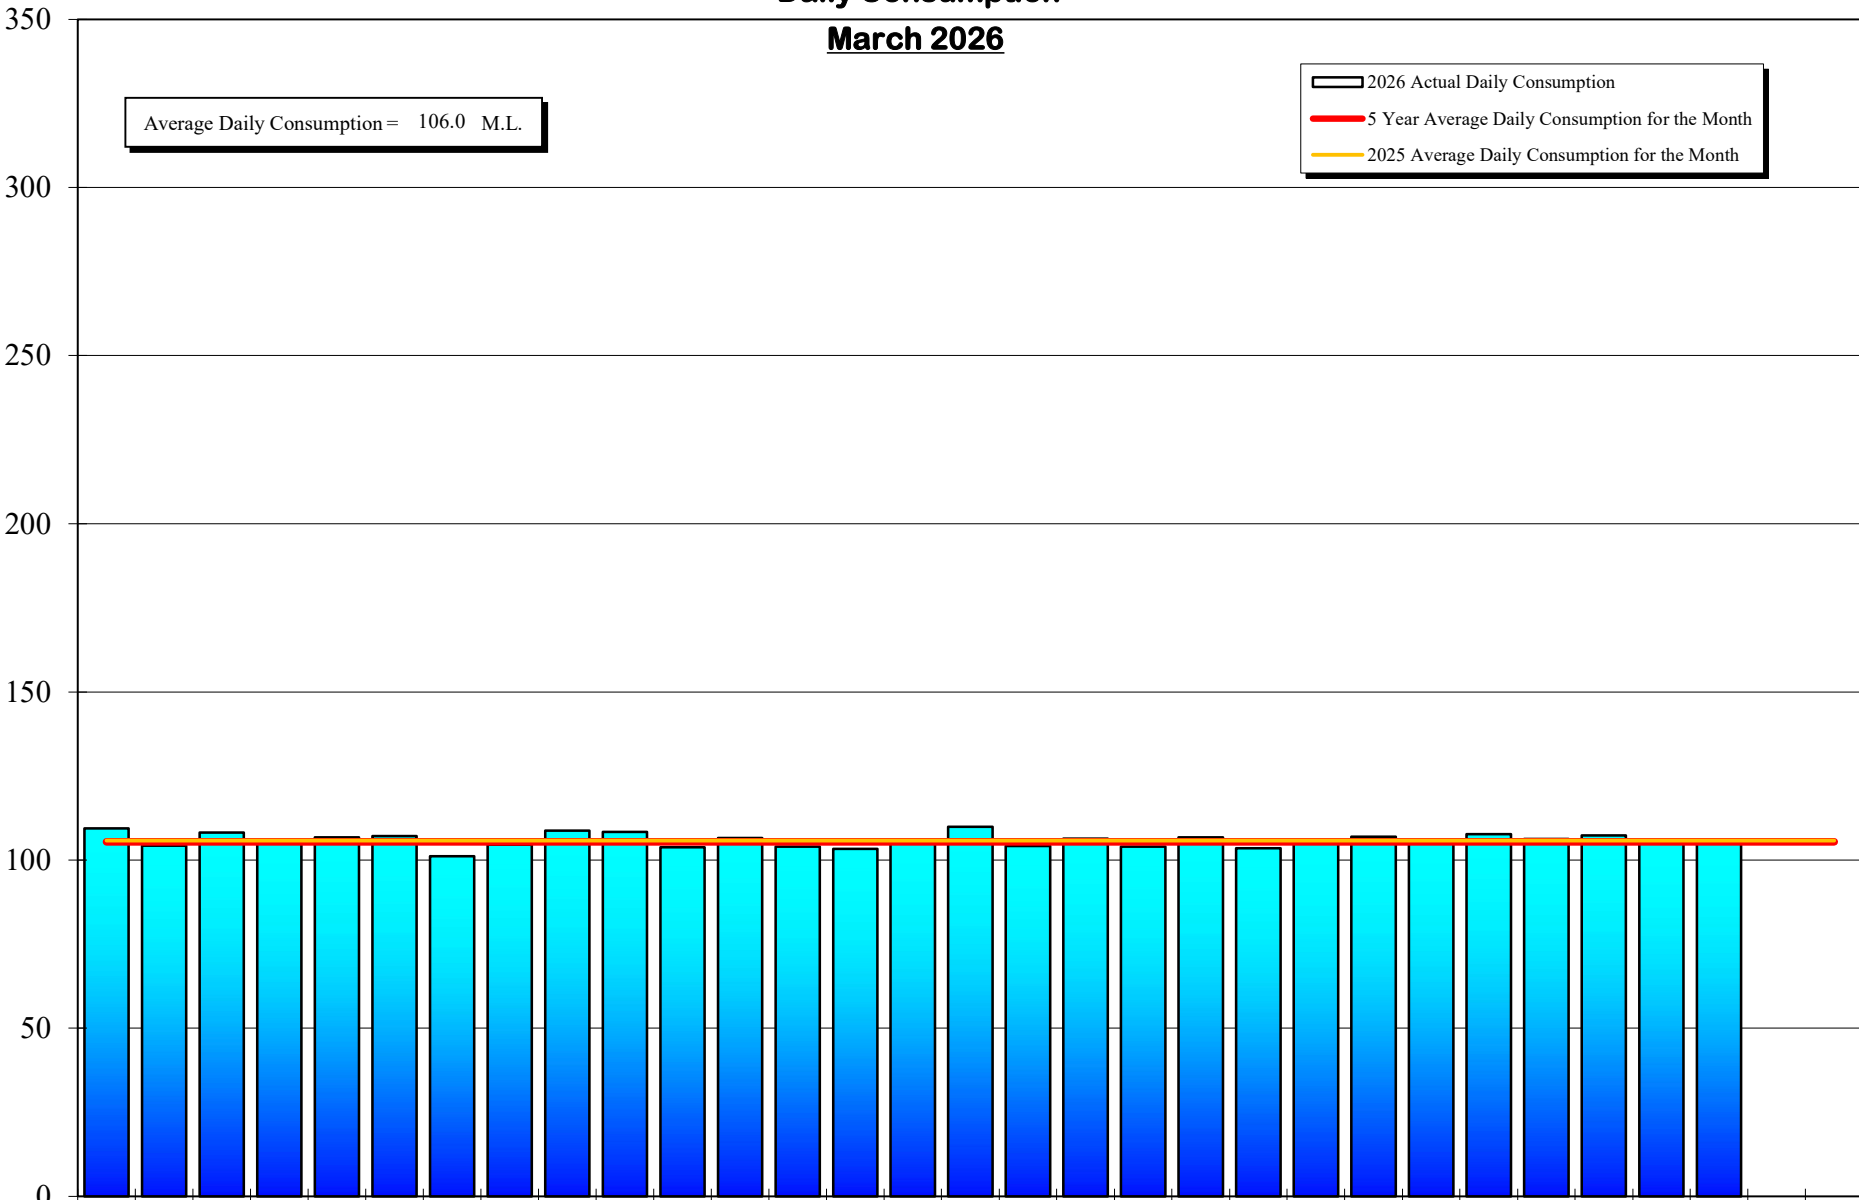

Daily Consumptions: - March 2026

Date	Total Consumption		Air Temperature @ Japan Gulch		Weather Conditions	Precipitation @ Sooke Res.: 12:00am to 12:00am			
	(ML) ¹	(MIG) ²	High (°C)	Low (°C)		Rainfall (mm)	Snowfall ⁷ (mm)	Total Precip.	
01 (Sun)	109.4	24.1	11	0	Cloudy / P. Sunny / Showers	0.2	0.0	0.2	
02 (Mon)	104.3	23.0	11	1	Sunny	0.0	0.0	0.0	
03 (Tue)	108.2	23.8	11	5	Cloudy / Showers	7.0	0.0	7.0	
04 (Wed)	106.1	23.3	11	6	Cloudy / P. Sunny / Showers	11.5	0.0	11.5	
05 (Thu)	106.7	23.5	11	5	Cloudy / P. Sunny / Showers	2.4	0.0	2.4	
06 (Fri)	107.1	23.6	8	6	Cloudy / Showers	8.4	0.0	8.4	
07 (Sat)	101.1	<=Min	22.2	13	7	Cloudy / Showers	5.0	0.0	5.0
08 (Sun)	104.6	23.0	10	1	Cloudy / P. Sunny / Showers	1.7	0.0	1.7	
09 (Mon)	108.7	23.9	5	0	Cloudy / P. Sunny / Showers	2.7	0.0	2.7	
10 (Tue)	108.4	23.9	5	-1	Cloudy / P. Sunny / Showers	11.9	0.0	11.9	
11 (Wed)	103.8	22.8	10	2	Cloudy / Rain	39.5	0.0	39.5	
12 (Thu)	106.6	23.5	5	2	Cloudy / Showers	10.2	0.0	10.2	
13 (Fri)	104.0	22.9	6	1	Cloudy / Showers	1.0	0.0	1.0	
14 (Sat)	103.3	22.7	7	0	Cloudy / P. Sunny / Showers	0.2	0.0	0.2	
15 (Sun)	106.2	23.4	7	1	Cloudy / Showers	9.4	0.0	9.4	
16 (Mon)	109.9	<=Max	24.2	10	2	Cloudy / Fog / Rain	27.3	0.0	27.3
17 (Tue)	104.2	22.9	11	8	Cloudy / Fog / Showers	10.8	0.0	10.8	
18 (Wed)	106.4	23.4	13	8	Cloudy / Fog / Showers	14.8	0.0	14.8	
19 (Thu)	104.0	22.9	14	9	Cloudy / Fog / Showers	8.4	0.0	8.4	
20 (Fri)	106.7	23.5	13	3	Cloudy / Rain	18.5	0.0	18.5	
21 (Sat)	103.5	22.8	10	1	Cloudy / P. Sunny	0.0	0.0	0.0	
22 (Sun)	105.8	23.3	9	2	Cloudy / P. Sunny / Showers	3.2	0.0	3.2	
23 (Mon)	106.9	23.5	10	0	Cloudy / P. Sunny	0.0	0.0	0.0	
24 (Tue)	106.1	23.4	11	4	Cloudy / P. Sunny / Showers	14.4	0.0	14.4	
25 (Wed)	107.7	23.7	6	1	Cloudy / P. Sunny / Showers	12.2	0.0	12.2	
26 (Thu)	106.3	23.4	9	0	Cloudy / P. Sunny / Showers	0.2	0.0	0.2	
27 (Fri)	107.3	23.6	12	2	Cloudy / P. Sunny	0.0	0.0	0.0	
28 (Sat)	105.2	23.1	11	2	Cloudy / P. Sunny	0.0	0.0	0.0	
29 (Sun)	105.7	23.3	6	0	Cloudy / P. Sunny / Showers	2.5	0.0	2.5	
30 (Mon)									
31 (Tue)									
TOTAL	2968.5 ML	653.09 MIG				220.9	0	220.9	
MAX	109.9	24.17	14	9		39.5	0	39.5	
AVG	106.0	23.32	9.6	2.7		7.9	0	7.9	
MIN	101.1	22.25	5	-1		0.0	0	0.0	

1. ML = Million Litres

2. 10% of snow depth applied to rainfall figures for snow to water equivalent.


Average Rainfall for March (1914-2025)	158.6 mm
Actual Rainfall: March	220.9 mm
% of Average	139%
Average Rainfall (1914-2025): Sept 01 - Mar 29	1,403.2 mm
Actual Rainfall (2025/26): Sept 01 - Mar 29	1,534.9 mm
% of Average	109%

Number days with precip. 0.2 or more
23

Water spilled at Sooke Reservoir to date (since Sept. 1) = 4.13 Billion Imperial Gallons
18.80 Billion Litres


SOOKE LAKE RESERVOIR STORAGE SUMMARY

2025 / 2026

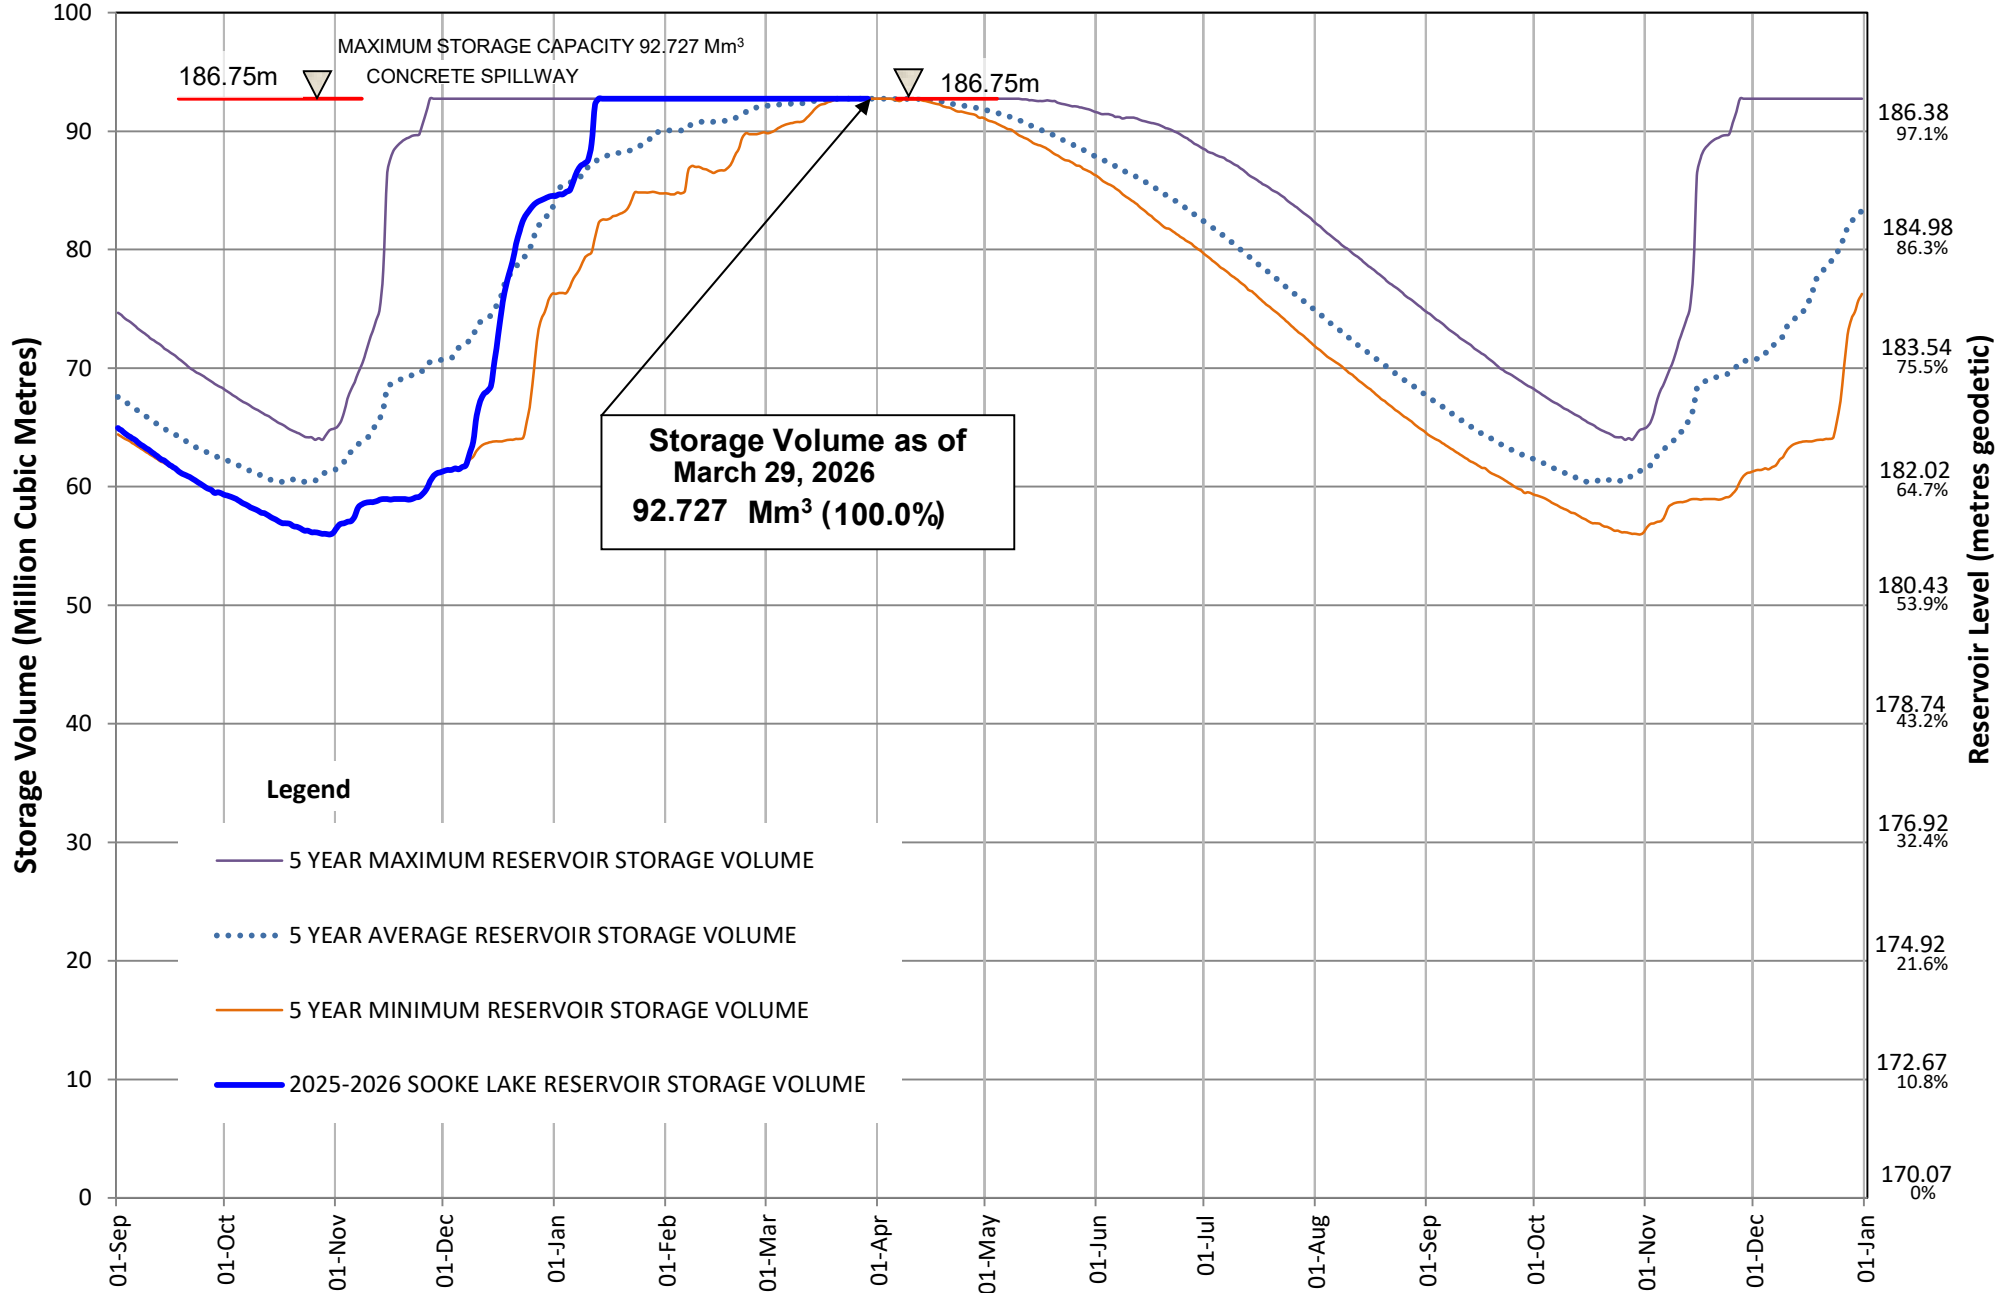

Sooke Lake Reservoir Storage Level

Water Supply Management Plan

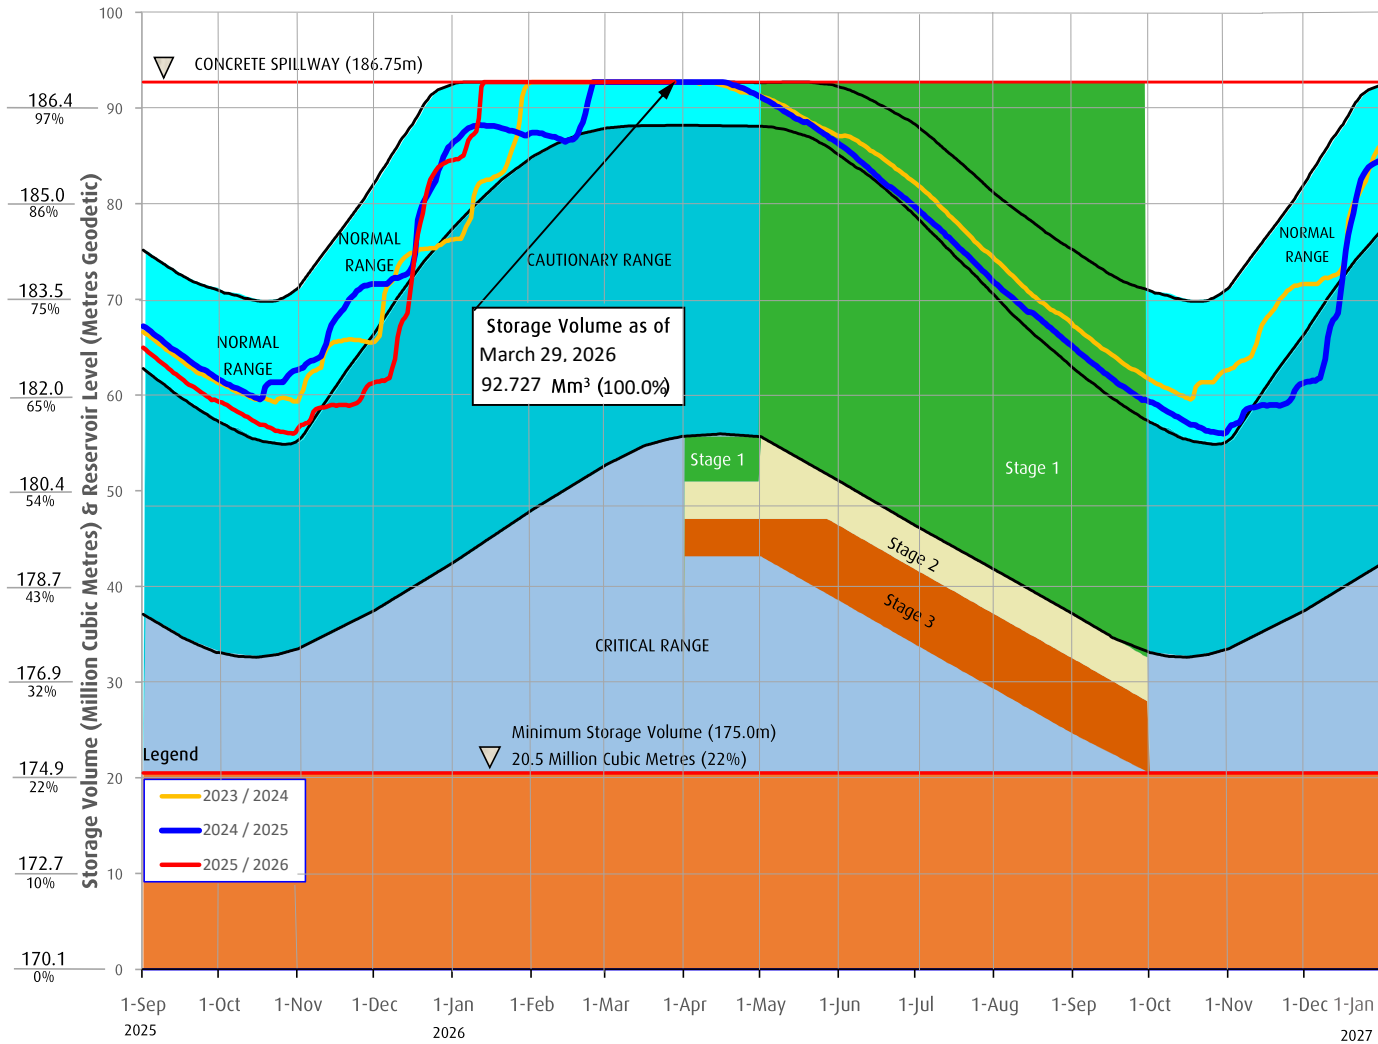

FAQs

How are water restriction stages determined?

Several factors are considered when determining water use restriction stages, including,

1. Time of year and typical seasonal water demand trends;
2. Precipitation and temperature conditions and forecasts;
3. Storage levels and storage volumes of water reservoirs (Sooke Lake Reservoir and the Goldstream Reservoirs) and draw down rates;
4. Stream flows and inflows into Sooke Lake Reservoir;
5. Water usage, recent consumption and trends; and customer compliance with restriction;
6. Water supply system performance.

The Regional Water Supply Commission will consider the above factors in making a determination to implement stage 2 or 3 restrictions, under the Water Conservation Bylaw.

At any time of the year and regardless of the water use restriction storage, customers are encouraged to limit discretionary water use in order to maximize the amount of water in the Regional Water Supply System Reservoirs available for nondiscretionary potable water use.

Stage 1 is normally initiated every year from May 1 to September 30 to manage outdoor use during the summer months. During this time, lawn watering is permitted twice a week at different times for even and odd numbered addresses.

Stage 2 is initiated when it is determined that there is an acute water supply shortage. During this time, lawn water is permitted once a week at different times for even and odd numbered addresses.

Stage 3 is initiated when it is determined that there is a severe water supply shortage. During this time, lawn watering is not permitted. Other outdoor water use activities are restricted as well.

For more information, visit www.crd.bc.ca/drinkingwater

Useable Reservoir Volumes in Storage for March 29, 2026

