



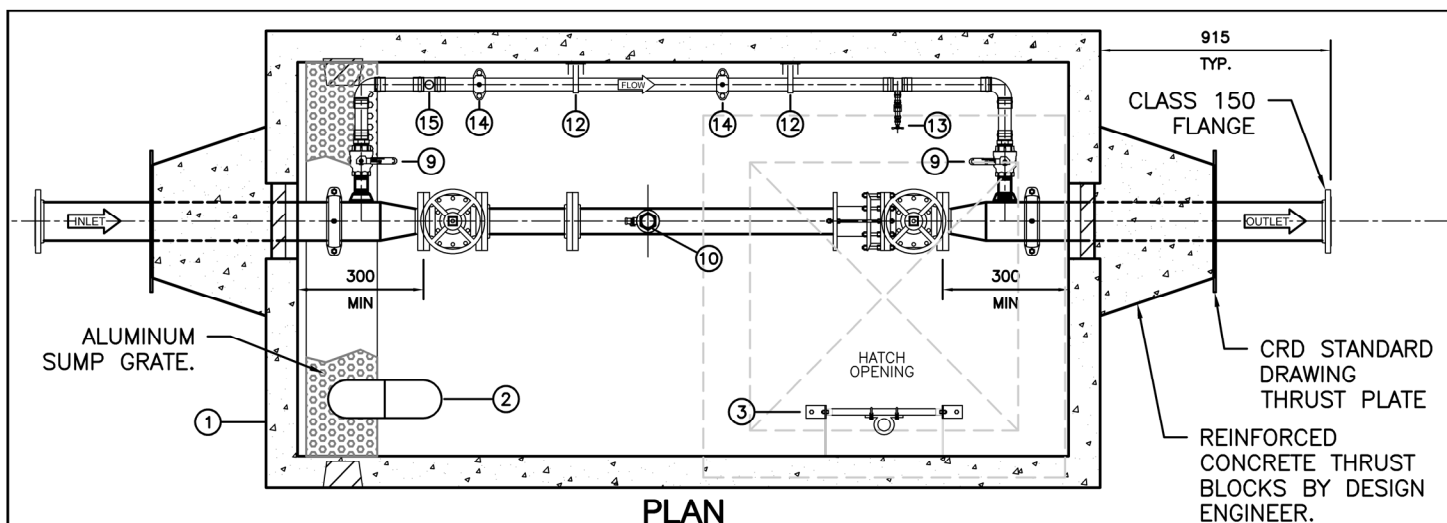

PLAN

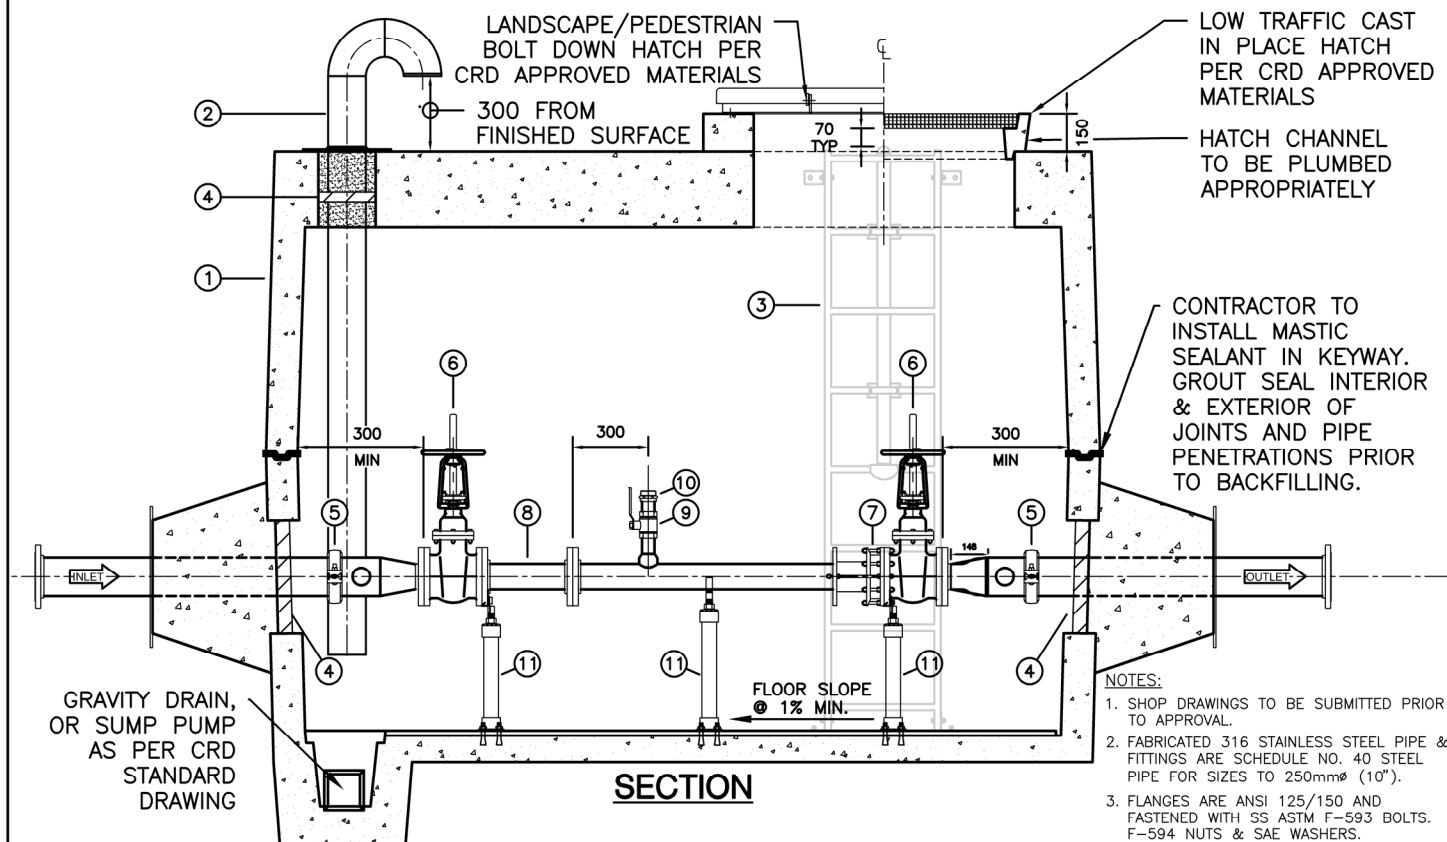

SECTION

LIST OF MATERIALS

ITEM	DESCRIPTION	QUA.
①	PRECAST CONCRETE CHAMBER c/w BLACK EXTERIOR COATING TO BE APPROVED BY CRD	1
②	150mm (6") VENT PIPE c/w PUDDLE FLANGE, EPOXY GREY AND MESH SCREEN. VENT SUPPORT AS PER MANUFACTURERS RECOMMENDATIONS.	1
③	ALUMINUM LADDER c/w RETRACTABLE SAFETY POST PER CRD APPROVED MATERIALS LIST.	1
④	LINK SEAL ASSEMBLY FOR STEEL PIPE.	3
⑤	STAINLESS STEEL GROOVED PIPE COUPLING.	2
⑥	RHO OS&Y GATE VALVE.	2
⑦	FxF RESTRAINT DISMANTLING JOINT ROMAC DJ400 OR APPROVED EQUAL.	1

ITEM	DESCRIPTION	QUA.
⑧	TEMPORARY SPOOL FOR CRD SUPPLIED METER. SPOOL DIMENSIONS TO BE CONFIRMED.	2
⑨	50mm (2") STAINLESS STEEL BALL VALVE.	3
⑩	65mm (2.5") BRASS MALE FIRE HOSE ADAPTOR.	1
⑪	ADJUSTABLE GALVANIZED STEEL FLANGE SUPPORT OR APPROVED EQUIVALENT AND SECURED TO FLOOR WITH ANCHOR BOLTS.	2
⑫	BYPASS ASSEMBLY PIPE SUPPORT	2
⑬	19mm STAINLESS STEEL BALL VALVE c/w HOSE BIB.	1
⑭	50mm (2") STAINLESS STEEL GROOVED PIPE COUPLING.	2
⑮	25mm (1") CONNECTION FOR SUMP DRAIN ASSEMBLY c/w PLUG. NOT REQUIRED IF ELECTRIC PUMP INSTALLED	1

revision date: NOV. 2024 scale: N.T.S.

standard drawing no.:

3.1

CRD

Making a difference...together

**WATER SERVICE
METER CHAMBER**