


SIDE VIEW

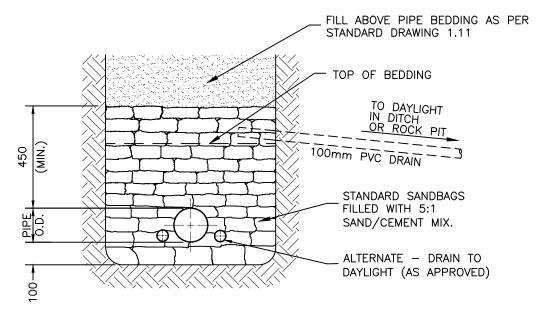

SECTION

NOTES:

TRENCH DAMS TO BE CONSTRUCTED:

- ON PIPE INSTALLATIONS WITH 10% to 15% SLOPE, NOT MORE THAN 30 METRES APART
- ON PIPE INSTALLATIONS WITH 15% to 30% SLOPE, NOT MORE THAN 15 METRES APART
- AS DIRECTED BY THE ENGINEER ON SITE
- · WHERE PIPE INSTALLATION EXCEEDS 30% REFER TO STANDARD DRAWING 4.2

ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS NOTED



TRENCH DAMS FOR SLOPES 10% TO 30%

revision date: Sept. 2024	scale:	N.T.S.
standard d	Irawina	no.:
4.3		